


0' 2' 4' 6' 8' 10' 12' 14'


LEGEND




FIRE SPRINKLER NOTES

1. ALL MATERIAL AND METHODS SHALL CONFORM TO THE REQUIREMENTS OF NFPA 13, 2010, AND THE CITY OF SACRAMENTO FIRE DEPARTMENT.
2. THIS PLAN IS A MODIFICATION TO AN EXISTING WET PIPE SYSTEM.
3. TENANT REMODEL AREA IS LIGHT AND ORDINARY HAZARD.
4. FOR ALL NEW ARM OVERS AND DROPS, SEE DETAILS 1 AND 2.
5. ALL NEW PIPING IS BLACK STEEL DYNATHREAD PIPE WITH THREADED OR MECHANICAL TEE FITTINGS.
6. THIS CONTRACT DOES NOT INCLUDE ANY MATERIAL OR DEVICE, IF REQUIRED, TO IMPROVE THE STRUCTURAL INTEGRITY OF THE BUILDING AND ITS ABILITY TO CARRY THE LOAD OF THE FIRE SPRINKLER SYSTEM.
7. ANY NEW HANGERS BEING INSTALLED UNDER THIS CONTRACT SHALL CONFORM TO NFPA 13, 2010, CHAPTER 9.
8. ALL NEW OR RELOCATED SSP SPRINKLERS ARE TO BE QUARTER-POINTED IN CEILING TILE.
9. EXISTING TEST DEVICES ARE TO BE USED FOR THIS TENANT IMPROVEMENT. (i.e. ITV, AND FLOW SWITCH)
10. LOCATION OF SPRINKLERS AND PIPING MAY BE MODIFIED TO ACCOMMODATE UNFORESEEN MECHANICAL, STRUCTURAL OR OTHER FIELD CONDITIONS THAT MAY NOT APPEAR AT TIME OF SUBMITTAL AND MAY REQUIRE FIELD VERIFICATION.
11. SMALL ROOMS RULE UTILIZED PER SECTION 3.3.17 NFPA 13, 2010.


DETAILS




1 SPRINKLER ADDITION




2 SPRINKLER RELOCATION




3 KWIK BOLT TZ



4 KWIK HUS-EZI




5 SIDE BEAM BRACKET

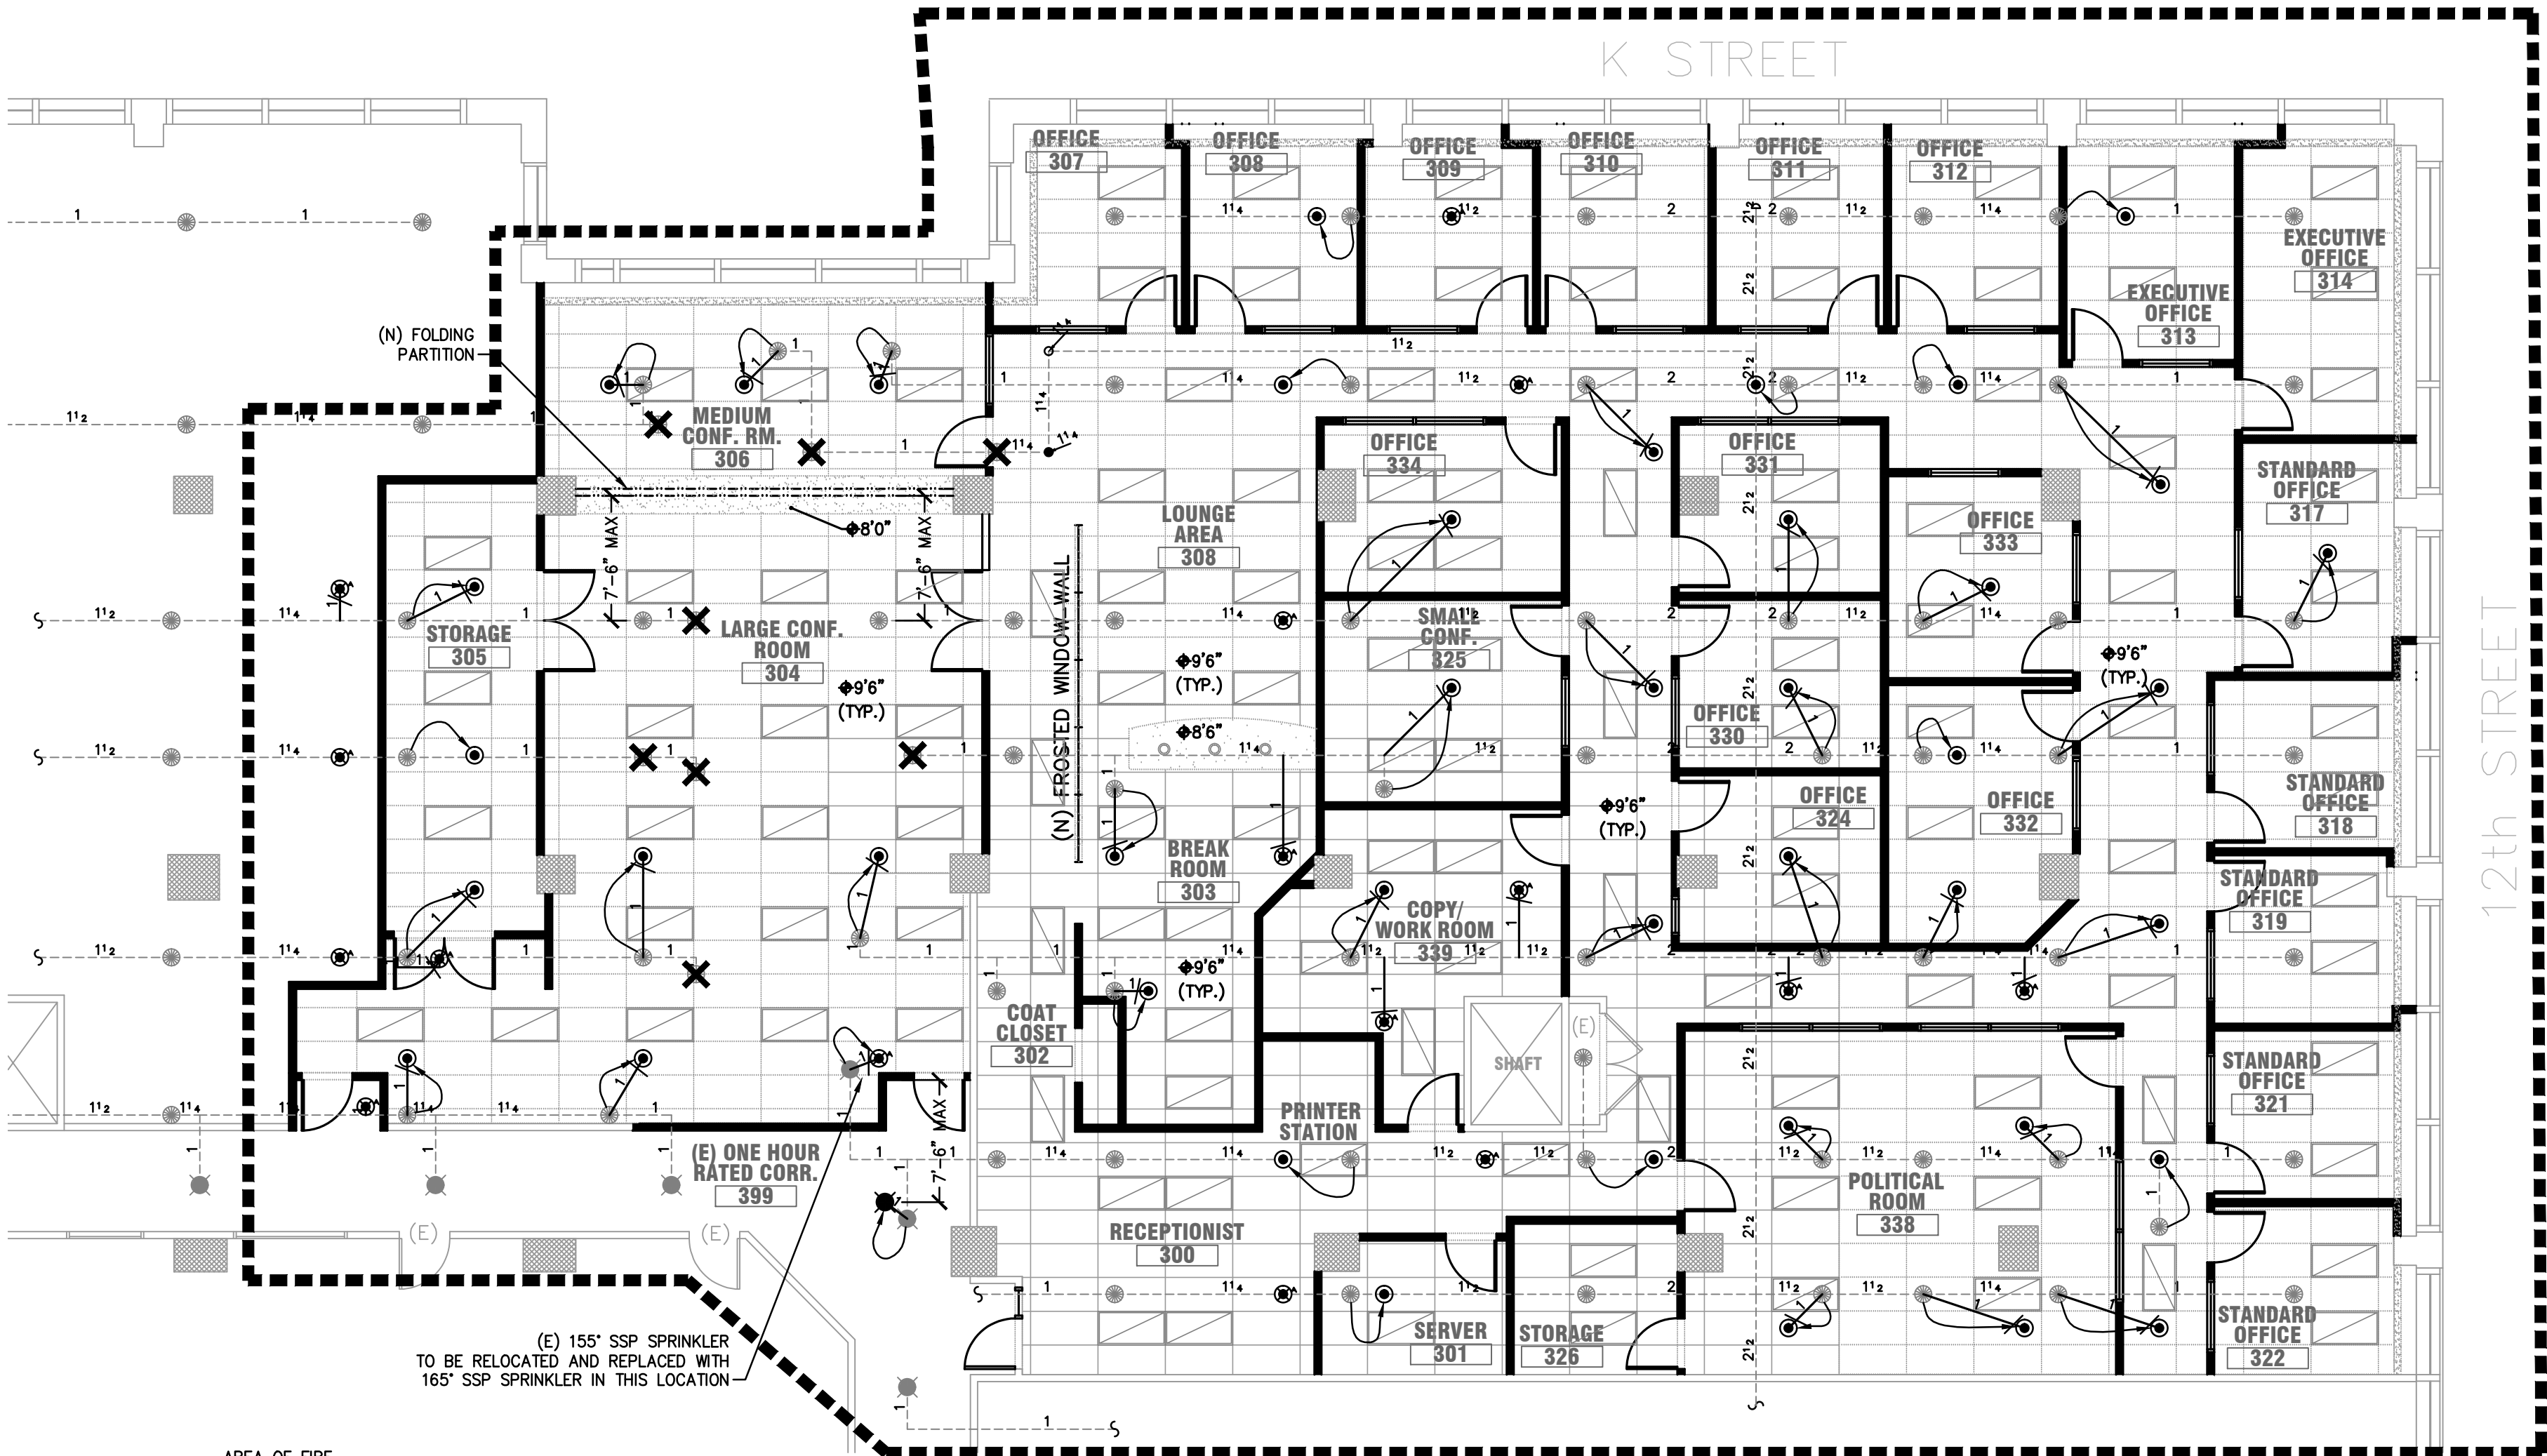

FIRE SPRINKLER PLAN

1/8"=1'-0"



KEY PLAN

NTS

| FIRE SPRINKLER LEGEND                    |        |      |         |        |          |         |          |      |          |          |   |
|--|--------|------|---------|--------|----------|---------|----------|------|----------|----------|---|
| SYMBOL                                   | SIN #  | SIZE | MAKE    | MODEL  | STYLE    | FINISH  | K-FACTOR | TEMP | RESPONSE | QUANTITY | NOTES   |
| ●  | C3711  | 1/2  | CENTRAL | H      | 401      | WHT/BRA | 5.6      | 165° | SR       | N/A      | (E) 165° SSP SPRINKLERS                             |
| ●  | TY3231 | 1/2  | TYCO    | TY-FRB | SEMI-REC | CRM/CRM | 5.6      | 155° | QR       | N/A      | (E) 155° SSP SPRINKLERS IN CORRIDOR                 |
| ●  | TY3231 | 1/2  | TYCO    | TY-FRB | SEMI-REC | CRM/CRM | 5.6      | 155° | QR       | 1        | (E) 155° SSP SPRINKLERS IN CORRIDOR TO BE RELOCATED |
| ●  | C3711  | 1/2  | CENTRAL | H      | 401      | WHT/BRA | 5.6      | 165° | SR       | 43       | (E) 165° SSP SPRINKLERS TO BE RELOCATED             |
| ●  | TY3211 | 1/2  | TYCO    | TY-L   | 401      | WHT/BRA | 5.6      | 165° | SR       | 16       | (N) 165° SSP SPRINKLERS TO BE ADDED                 |
| ✕  |        |      |         |        |          |         |          |      |          | 7        | (E) SSP SPRINKLERS TO BE REMOVED                    |
| TOTAL NUMBER OF SPRINKLERS ON THIS SHEET |        |      |         |        |          |         |          |      |          | 60       | TOTAL NUMBER OF SPRINKLERS ON THIS CONTRACT         |
|  |        |      |         |        |          |         |          |      |          |          | 60  |



4426 YANKEE HILL ROAD  
ROCKLIN, CALIFORNIA 95677  
Ca. Lic. # 947274  
(916) 332-1266 FAX: 332-1256

Consultant

Project  
SEIU  
Service Employee  
International Union.

1130 K STREET, SUITE 300  
SACRAMENTO, CA 95814  
Sheet Title

FIRE SPRINKLER  
PLAN

|           |                  |                           |
|-----------|------------------|---------------------------|
| Architect | JOSUE F. DIAZ    |                           |
| Drawn By  | R. PEARSON       |                           |
| Revisions |                  |                           |
| NO.       | DATE             | DESCRIPTION               |
|           |                  |                           |
|           |                  |                           |
|           |                  |                           |
|           |                  |                           |
| REV.1     | AUG. 28, 2013    | REV. 1 PER TENANT REQUEST |
|           | AUG. 26, 2013    | FOR TENANT REVIEW.        |
| Job No.   | 13430            |                           |
| Date      | JANUARY 30, 2014 |                           |

Drawing No.

FP1