


TACTILE SIGNAGE LEGEND

- A "EXIT"
- B "EXIT ROUTE"
- C "EXIT STAIR DOWN"



- FINISH & CONTRAST:** CHARACTERS AND THEIR BACKGROUND SHALL HAVE A NON-GLARE FINISH. CHARACTERS SHALL CONTRAST WITH THEIR BACKGROUND, EITHER LIGHT ON A DARK BACKGROUND OR DARK ON A LIGHT BACKGROUND.
- CHARACTER TYPE:** CHARACTERS SHALL BE RAISED 1/32" MIN. AND SHALL BE SANS SERIF UPPERCASE.
- CHARACTER SIZE:** CHARACTERS SHALL BE A MIN. OF 5/8" AND A MAX. OF 7" HIGH.
- CHARACTER PLACEMENT:** CHARACTERS AND BRAILLE SHALL BE IN A HORIZONTAL FORMAT. BRAILLE SHALL BE DIRECTLY BELOW THE TACTILE CHARACTERS. FLUSH LEFT OR CENTERED. WHEN TACTILE TEXT IS MULTI-LINED, ALL BRAILLE SHALL BE PLACED TOGETHER BELOW ALL LINES OF TACTILE TEXT.
- BRAILLE:** CONTRACTED (GRADE 2) BRAILLE SHALL BE USED. DOTS SHALL BE 1/10" ON CENTER IN EACH CELL WITH 2/10" SPACE BETWEEN CELLS, MEASURED FROM THE SECOND COLUMN OF DOTS IN THE FIRST CELL TO THE FIRST COLUMN OF DOTS IN THE SECOND CELL. DOTS SHALL BE RAISED A MINIMUM OF 1/40" ABOVE THE BACKGROUND. BRAILLE DOTS SHALL BE DOTTED OR ROUNDED.

CEILING LEGEND

- ILLUMINATED EXIT SIGN W/ EMERGENCY BATTERY BACK-UP. COMPLY W/ 2013 CBC SECTION 1011. DIRECTIONAL ARROWS AS SHOWN.

EXIT CODE ANALYSIS

<b>OCCUPANT LOAD:</b>	
MEETING/ CONF. ROOMS	103 OCC.
LOUNGE	16 OCC.
OFFICE	29 OCC.
TOTAL OCCUPANT LOAD =	148 OCC.

**NUMBER OF EXITS REQUIRED: 2**  
NUMBER OF EXITS PROVIDED: 2

**ALLOWED TRAVEL DISTANCE: 300'**  
EXIT ROUTE 1 ACCESS TRAVEL DISTANCE: ±161'  
EXIT ROUTE 2 ACCESS TRAVEL DISTANCE: ±145'


**DOOR SEPARATION • SUITE:**  
TOTAL DIAGONAL DISTANCE: ±131'-5"  
THIRD OF DIAGONAL DISTANCE: ±45'-9-1/2"  
PROVIDED DISTANCE BETWEEN EXITS: ±48'-0"

**DOOR SEPARATION • CONF. ROOM:**  
TOTAL DIAGONAL DISTANCE: ±62'-4"  
THIRD OF DIAGONAL DISTANCE: ±20'-9-1/2"  
PROVIDED DISTANCE BETWEEN EXITS: ±36'-6"

FIRE EXTINGUISHER

- WALL MOUNTED FIRE EXTINGUISHER TO COMPLY W/ TITLE 19. FIRE EXTINGUISHERS SHALL HAVE A SERVICE TAG AFFIXED TO THEM WHICH PROVIDES PROOF THEY HAVE BEEN INSPECTED AND SERVICED BY A LICENSED FIRE EXTINGUISHER INSPECTOR. (ALL LOCATIONS ARE SUBJECT TO CHANGE AT FIRE INSPECTOR'S DISCRETION).

NOTE: 15' MAXIMUM TRAVEL DISTANCE REQUIRED - MINIMUM 2A:10-B:C RATING.



**principals**  
RUDY CALPO  
ALAN C. HOM  
DENNIS DONG  
ANDY C. KWONG  
LOANGLE R. NEWSOME  
KARL CHAN  
**associates**  
JOHN R. PETRUCELLI  
KARIN LYNN RYLANDER  
JILL HAW

2120 20TH STREET, SUITE ONE  
SACRAMENTO, CALIFORNIA 95818  
TEL: 916/446-7741 FAX: 916/446-0457  
C o n s u l t a n t

Project

**SEIU**  
**Service Employee**  
**International Union.**

1130 K STREET, SUITE 300  
SACRAMENTO, CA 95814

Sheet Title

EGRESS PLANS

The undersigned architect does not represent that these plans or the specifications in connection therewith are suitable, whether or not modified for any other site than the one for which they were specifically prepared. The architect disclaims responsibility for these plans and specifications if they are used in whole or in part at any other site.

The contractor shall verify and be responsible for all dimensions and conditions on the job and this office must be notified in writing of any variation from the dimensions and conditions shown by these drawings.

This drawing is not final or to be used for construction until signed by the architect and owner.


All drawings and written material appearing herein constitute the original and unpublished work of the Architect and the same may not be duplicated, used or disclosed without written consent of the Architect.

<b>Architect</b>		
<b>Drawn By</b> MK		
<b>Revisions</b>		
NO.	DATE	DESCRIPTION
-	FEB. 06, 2014	BID SET
REV. 3	JAN. 15, 2014	REV. 3 PER TENANT REQUEST
REV. 2	NOV. 15, 2013	REV. 2 PER TENANT REQUEST
REV. 1	AUG. 28, 2013	REV. 1 PER TENANT REQUEST
	AUG. 26, 2013	FOR TENANT REVIEW
<b>Job No.</b> 13189		
<b>Date</b> AUGUST, 19, 2013		

Drawing No.


**A1.1**

OF SHEETS

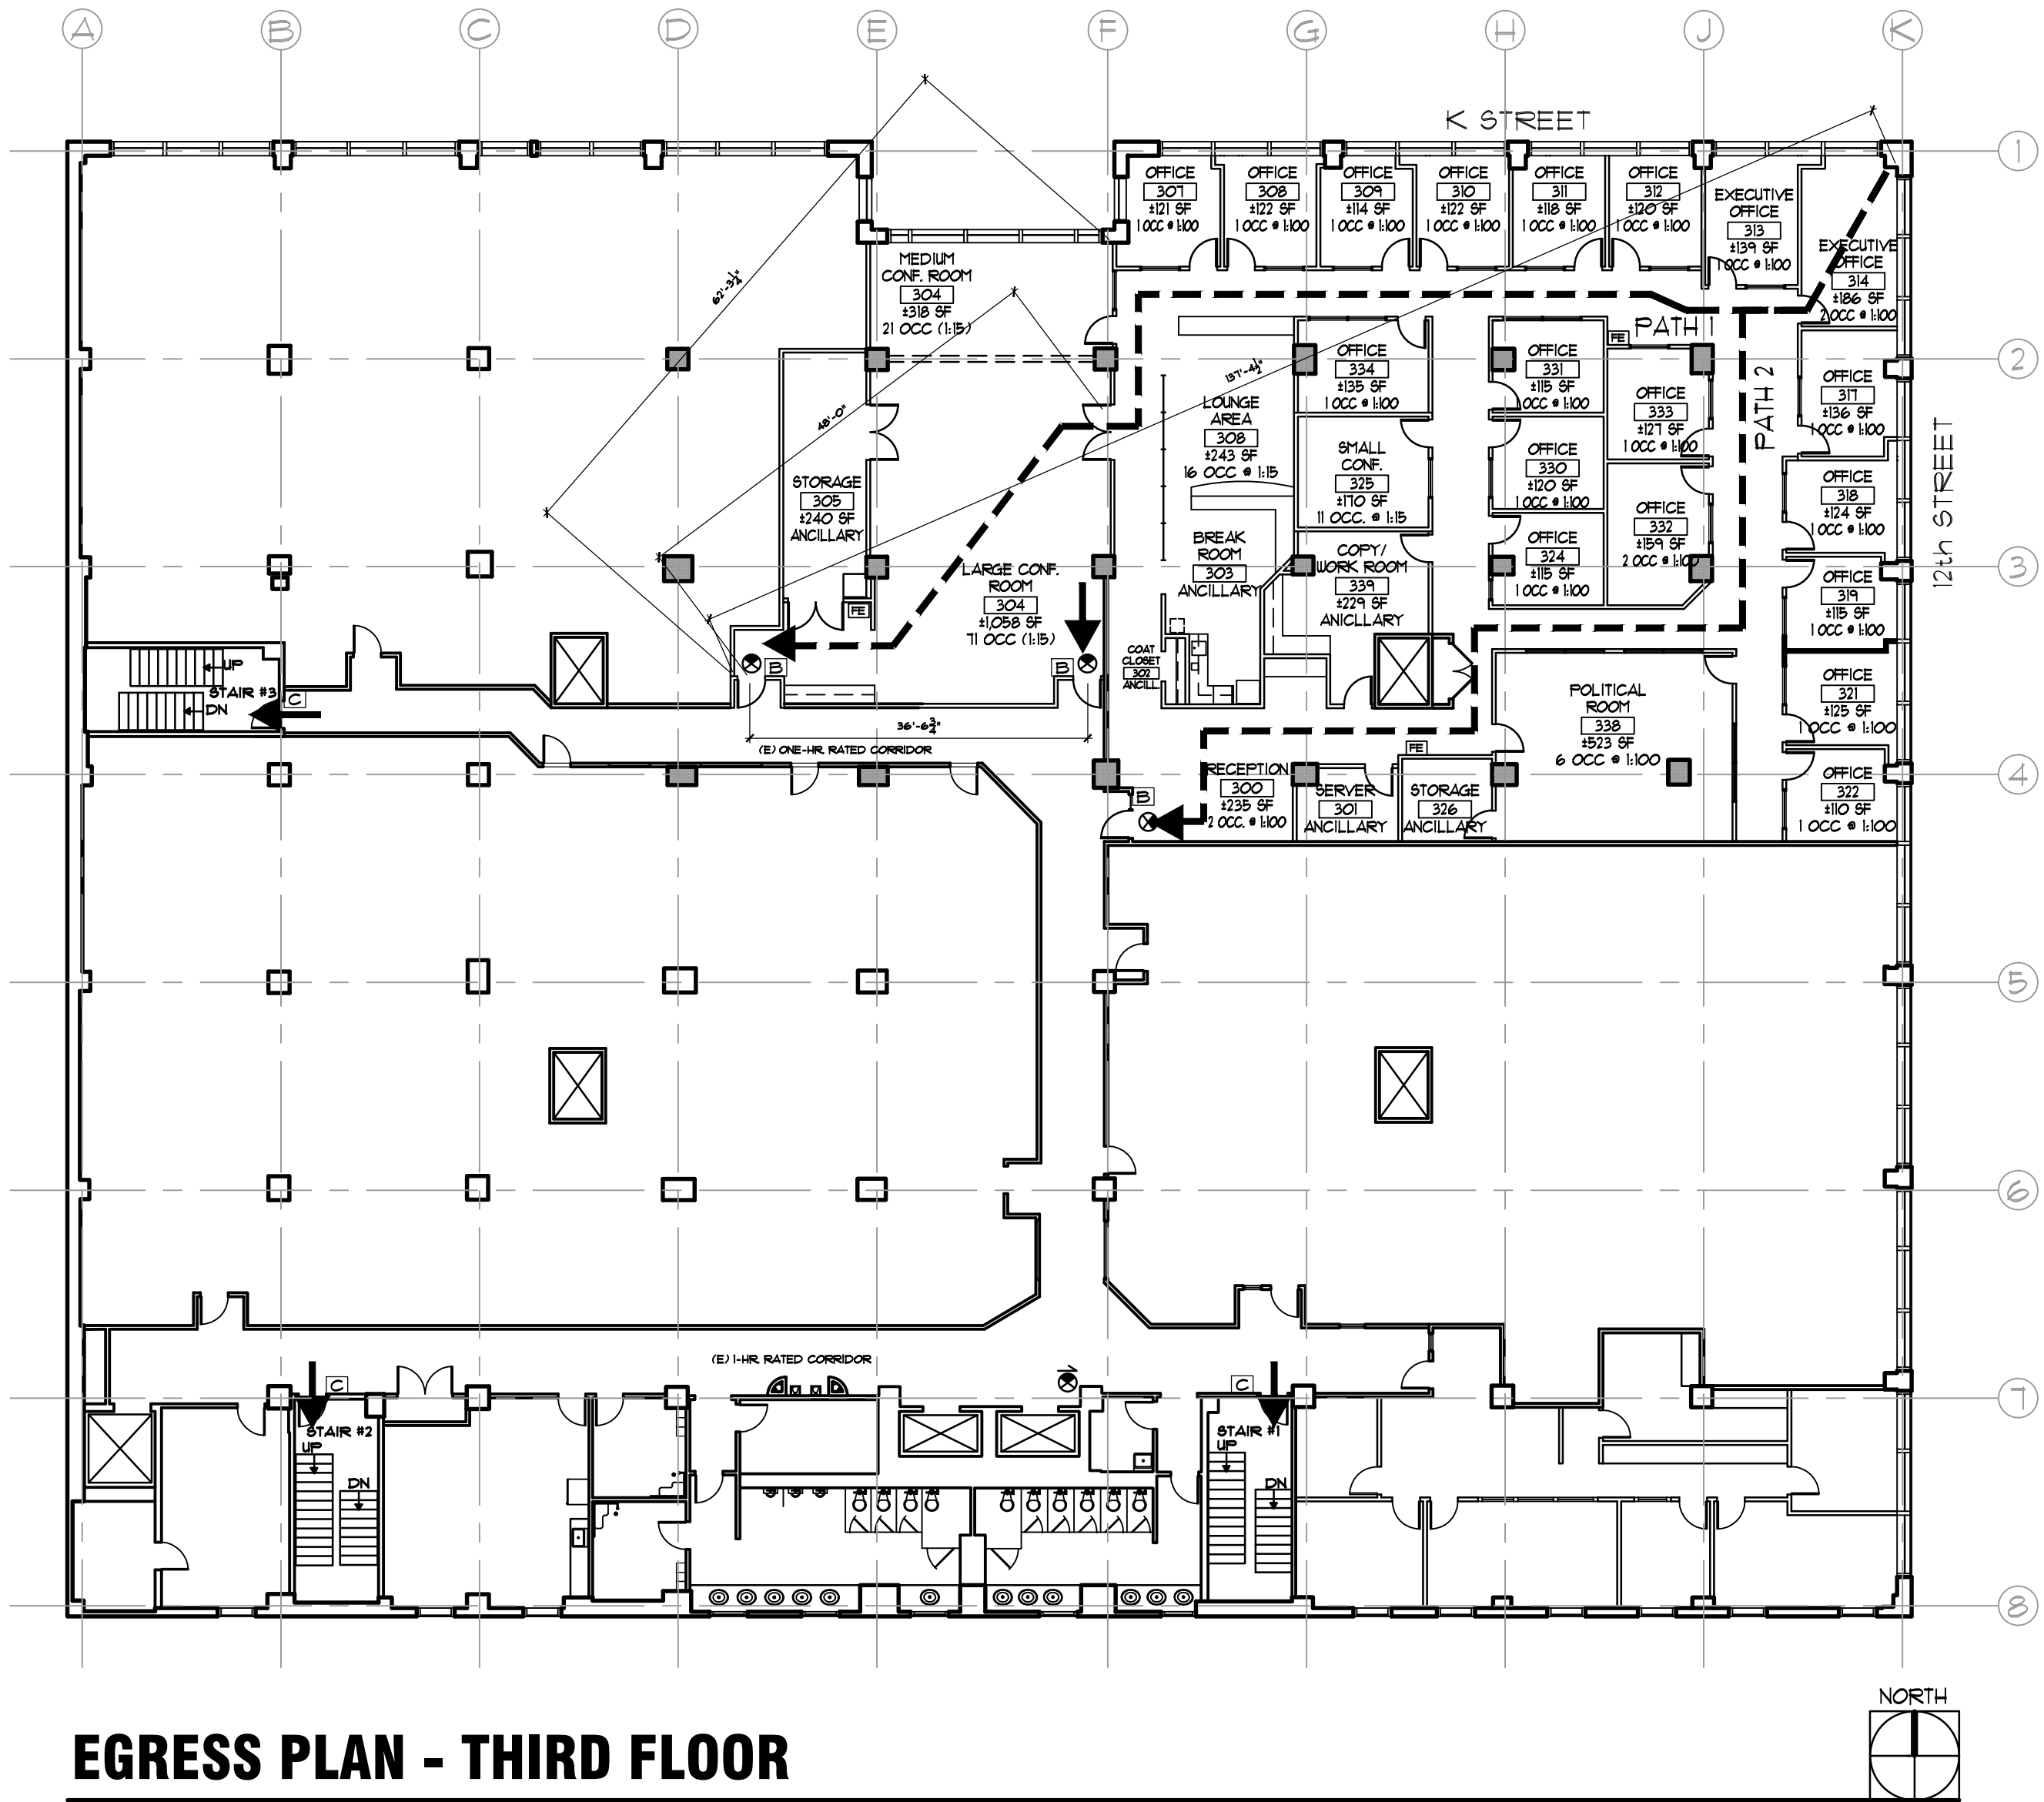

EGRESS PLAN - THIRD FLOOR

3/32" = 1'-0"

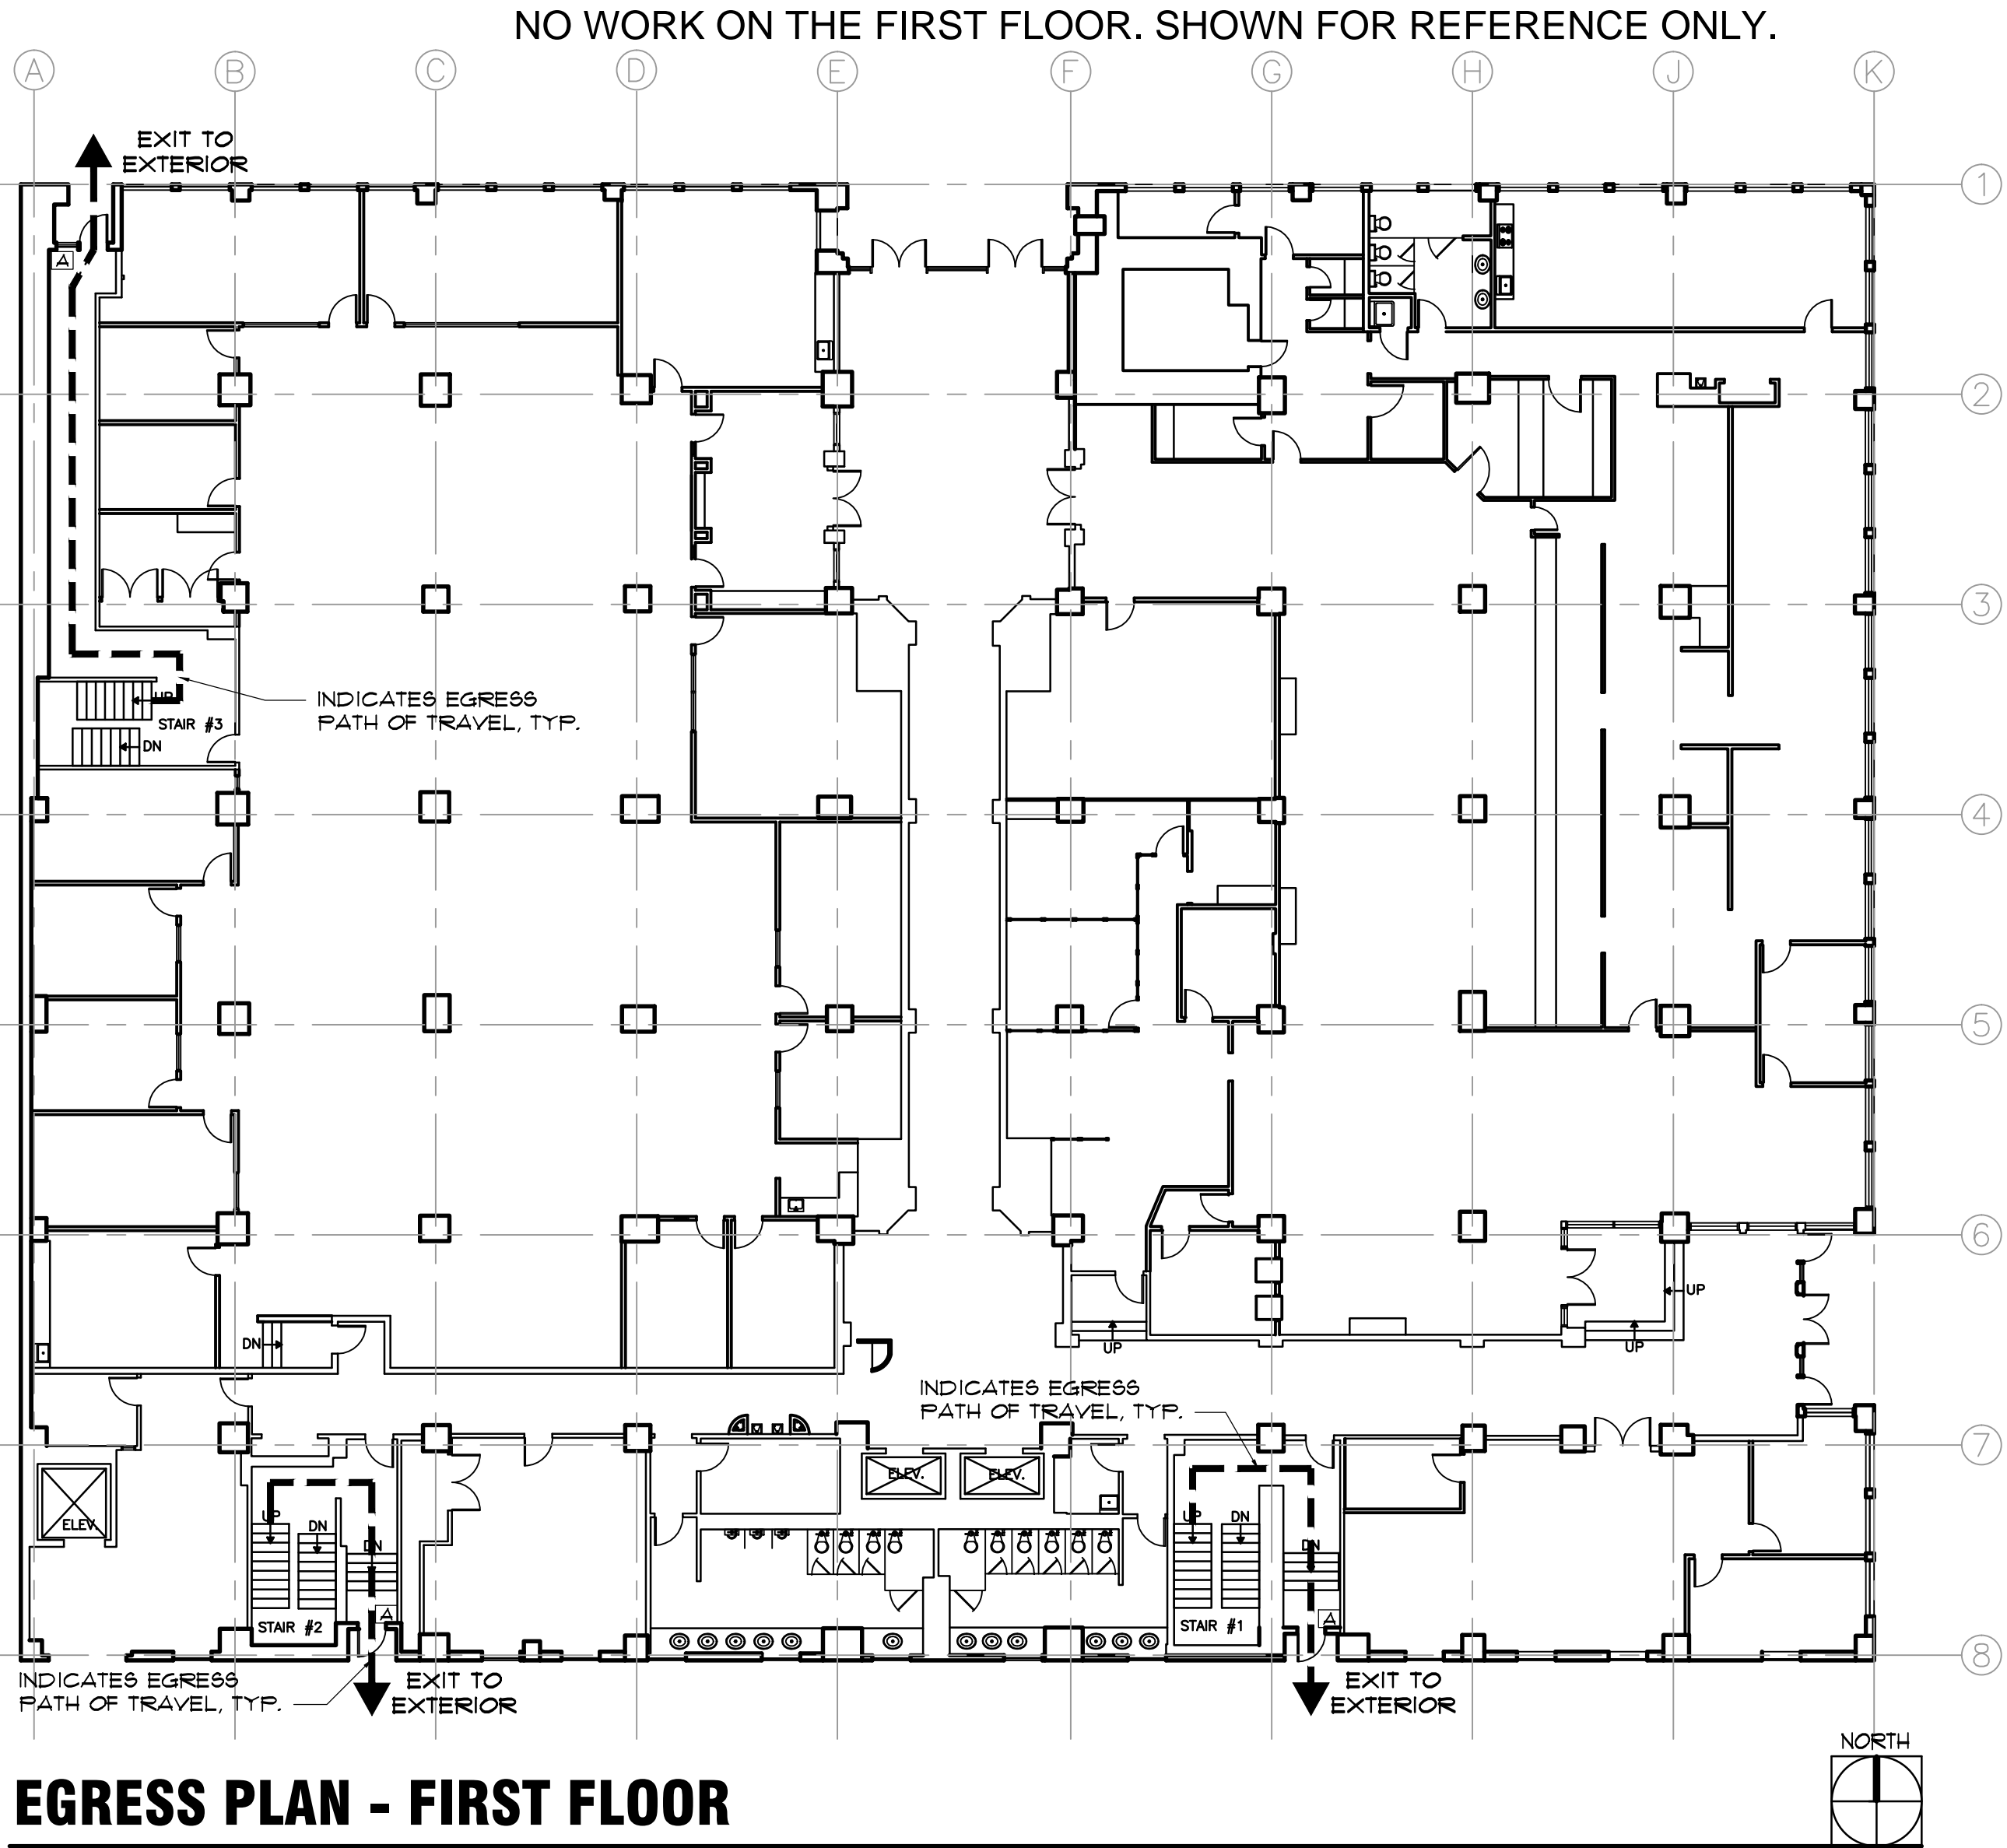

EGRESS PLAN - FIRST FLOOR

3/32" = 1'-0"